



**Technical and Test Institute
for Construction Prague**
Prosecká 811/76a
190 00 Prague
Czech Republic
eota@tzus.cz



Member of



www.eota.eu

European Technical Assessment

ETA 14/0294 of 16/02/2021

Technical Assessment Body issuing the ETA: Technical and Test Institute
for Construction Prague

Trade name of the construction product

edilon)(sedra Dex[®]-EA 2K,
edilon)(sedra Dex[®]-EA 2KC
edilon)(sedra Dex[®]-EA 2KH

**Product family to which the construction
product belongs**

Product area code: 33
Bonded injection type anchor for use in
cracked and uncracked concrete

Manufacturer

edilon)(sedra bv
Nijverheidsweg 23
NL-2031 CN Haarlem
The Netherlands

Manufacturing plant

Usine edilon)(sedra 600 712

**This European Technical Assessment
contains**

17 pages including 14 Annexes which form
an integral part of this assessment.

**This European Technical Assessment is
issued in accordance with regulation
(EU) No 305/2011, on the basis of**

EAD 330499-01-0601 Bonded fasteners for
use in concrete

This version replaces

ETA 14/0294 issued on 21/08/2014

Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full (excepted the confidential Annex(es) referred to above). However, partial reproduction may be made, with the written consent of the issuing Technical Assessment Body - Technical and Test Institute for Construction Prague. Any partial reproduction has to be identified as such.

1. Technical description of the product

The edilon)(sedra Dex[®]-EA 2K, edilon)(sedra Dex[®]-EA 2KC (faster curing time) and edilon)(sedra Dex[®]-EA 2KH (extended processing time) with steel elements is bonded anchor (injection type).

Steel elements can be galvanized or stainless steel threaded rod or rebar.

Steel element is placed into a drilled hole filled with injection mortar. The steel element is anchored via the bond between metal part, injection mortar and concrete. The anchor is intended to be used with embedment depth from 8 diameters to 20 diameters.

The illustration and the description of the product are given in Annex A.

2. Specification of the intended use in accordance with the applicable EAD

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The provisions made in this European Technical Assessment are based on an assumed working life of the anchor of 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the products in relation to the expected economically reasonable working life of the works.

3. Performance of the product and references to the methods used for its assessment

3.1 Mechanical resistance and stability (BWR 1)

| Essential characteristic | Performance |
|--|------------------|
| Static and quasi-static loading | |
| Resistance to steel failure (tension) | See Annex C1, C2 |
| Resistance to combined pull-out and concrete failure | See Annex C1, C2 |
| Resistance to concrete cone failure | See Annex C1, C2 |
| Edge distance to prevent splitting under load | See Annex C1, C2 |
| Robustness | See Annex C1, C2 |
| Maximum setting torque moment | See Annex B4 |
| Minimum edge distance and spacing | See Annex B4 |
| Resistance to steel failure (shear) | See Annex C3, C4 |
| Resistance to pry-out failure | See Annex C3, C4 |
| Resistance to concrete edge failure | See Annex C3, C4 |
| Displacements under short term and long term loading | See Annex C5 |
| Durability of metal parts | See Annex A3 |
| Seismic performance C1 | |
| Resistance to steel failure | See Annex C6 |
| Resistance to pull-out | See Annex C6 |
| Factor for annular gap | See Annex C6 |

3.2 Hygiene, health and environment (BWR 3)

No performance determined.

3.3 General aspects relating to fitness for use

Durability and serviceability are only ensured if the specifications of intended use according to Annex B 1 are kept.

4. Assessment and verification of constancy of performance (AVCP) system applied with reference to its legal base

According to the Decision 96/582/EC of the European Commission¹ the system of assessment verification of constancy of performance (see Annex V to Regulation (EU) No 305/2011) given in the following table apply.

| Product | Intended use | Level or class | System |
|-----------------------------------|--|-----------------------|---------------|
| Metal anchors for use in concrete | For fixing and/or supporting to concrete, structural elements (which contributes to the stability of the works) or heavy units | - | 1 |

5. Technical details necessary for the implementation of the AVCP system, as provided in the applicable EAD

5.1 Tasks of the manufacturer

The manufacturer may only use raw materials stated in the technical documentation of this European Technical Assessment.

The factory production control shall be in accordance with the control plan which is a part of the technical documentation of this European Technical Assessment. The control plan is laid down in the context of the factory production control system operated by the manufacturer and deposited at Technical and Test Institute for Construction Prague.² The results of factory production control shall be recorded and evaluated in accordance with the provisions of the control plan.

5.2 Tasks of the notified bodies

The notified body shall retain the essential points of its actions referred to above and state the results obtained and conclusions drawn in a written report.

The notified certification body involved by the manufacturer shall issue a certificate of constancy of performance of the product stating the conformity with the provisions of this European Technical Assessment.

In cases where the provisions of the European Technical Assessment and its control plan are no longer fulfilled the notified body shall withdraw the certificate of constancy of performance and inform Technical and Test Institute for Construction Prague without delay.

Issued in Prague on 16.02.2021

By


Ing. Mária Schaan

Head of the Technical Assessment Body


¹ Official Journal of the European Communities L 254 of 08.10.1996

² The control plan is a confidential part of the documentation of the European Technical Assessment, but not published together with the ETA and only handed over to the approved body involved in the procedure of AVCP.

Threaded rod

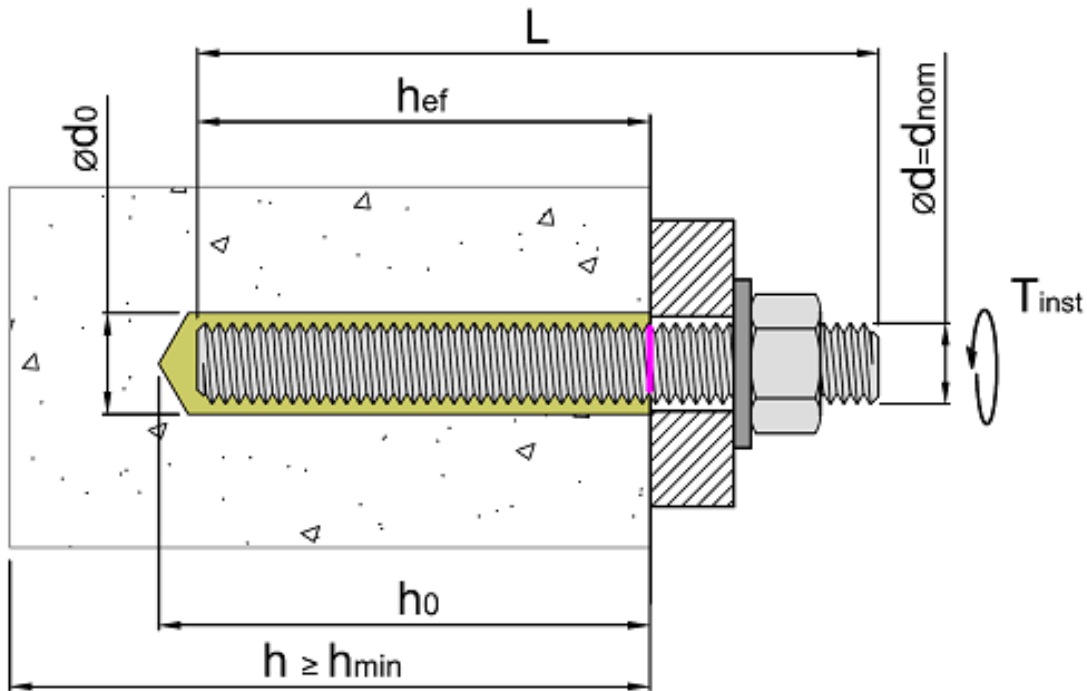

Reinforcing bar

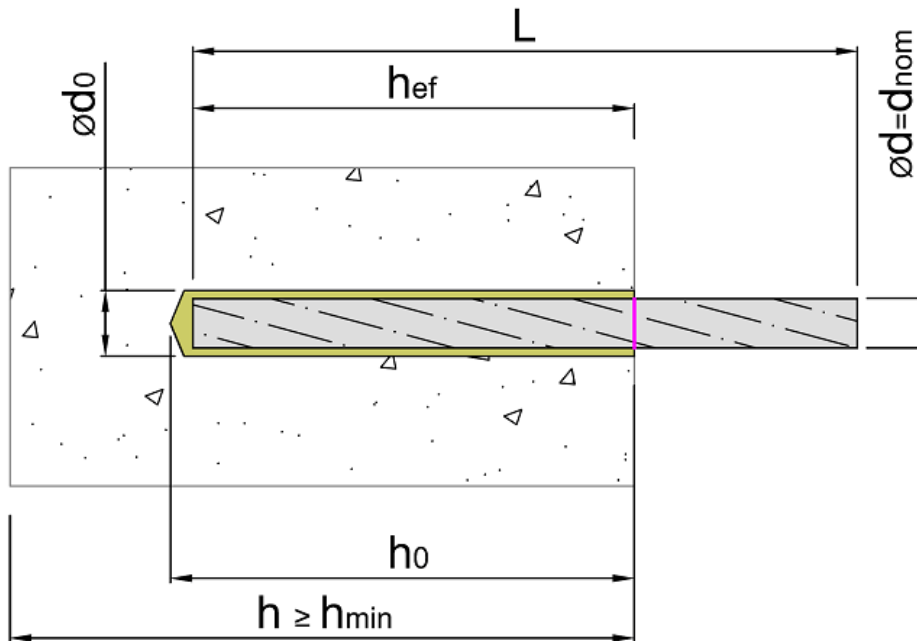

edilon)(sedra Dex[®]-EA 2K, edilon)(sedra Dex[®]-EA 2KC,
edilon)(sedra Dex[®]-EA 2KH


Product description
Installed conditions

Annex A 1

Adhesive cartridges :


A. 2 component coaxial cartridge :

(150 ml / 380 ml / 400 ml / 410 ml)

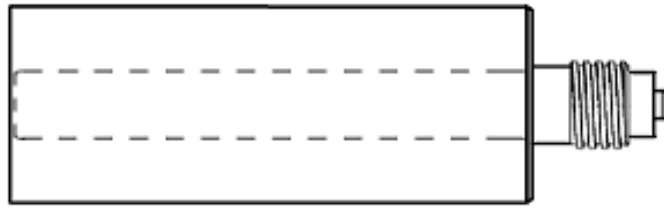


B. 2 component side by side cartridge :

(350 ml / 825 ml)

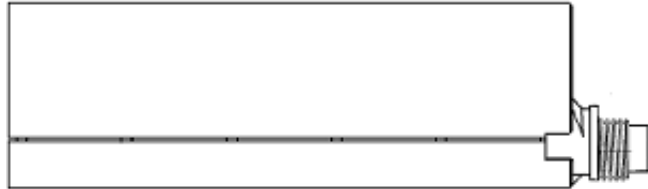

C. 2 component foil bag in a single piston cartridge :

(150 ml / 170 ml / 300 ml / 550 ml / 850 ml)

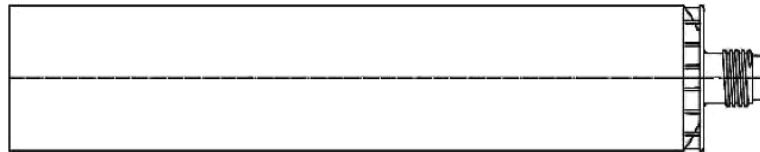

D. 2 component foil bag in a single piston cartridge :

(150 ml / 170 ml / 300 ml / 550 ml / 850 ml)



Marking on the adhesive cartridges :

- Identifying mark of the producer, trade name
- Charge code number


- Storage life, curing and processing time
- Health and safety information

Special static mixing nozzles :


KWM




RCM



EZM




RME

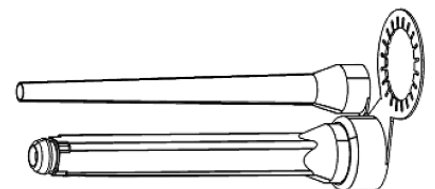

TBM



KRM for use with 850 ml




edilon)(sedra Dex[®]-EA 2K, edilon)(sedra Dex[®]-EA 2KC, edilon)(sedra Dex[®]-EA 2KH

Product description
Injection system

Annex A 2

Threaded rod M8, M10, M12, M16, M20, M24, M27, M30

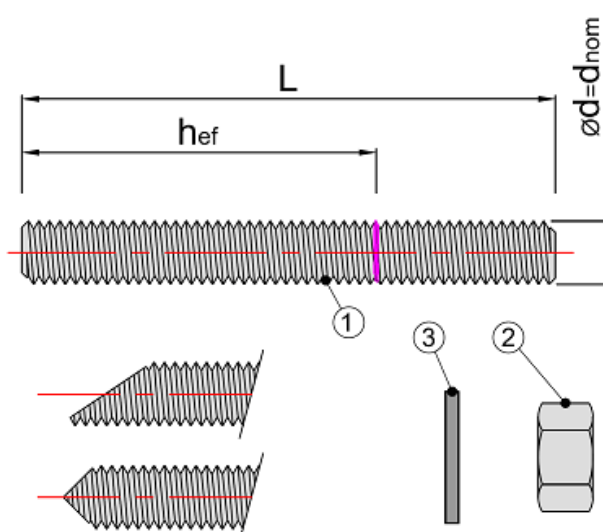

Standard commercial threaded rod with marked embedment depth

| Carbon Steel , Zinc electroplated coating $\geq 5 \mu\text{m}$ according EN-ISO 4042 Carbon Steel , Hot dip galvanized coating $\geq 40 \mu\text{m}$ according EN-ISO 1461 and EN-ISO10684 Carbon Steel , Zinc diffusion coating $\geq 15 \mu\text{m}$ acc. to EN 13811 | | |
|--|---------------------------|---|
| Part | Designation | Material and EN / ISO reference |
| 1. | Threaded rod M8 to M30 | Carbon Steel , according to EN 10087 or EN 10263 grade 4.6, 5.8, 8.8 and 10.9 acc. to EN-ISO 898-1 |
| 2. | Hexagon nut M8 to M30 | EN-ISO 4032, Steel according to threaded rod grade according to EN-ISO 898-2 |
| 3. | Washer | EN ISO 887, EN-ISO 7089, EN-ISO 7093 or EN-ISO 7094, Steel according to threaded rod |

*Galvanized rod of high strength are sensitive to hydrogen induced brittle failure

| Stainless Steel | | |
|------------------------|---------------------------|--|
| Part | Designation | Material and EN / ISO reference |
| 1. | Threaded rod M8 to M30 | Stainless Steel , 1.4401, 1.4404 or 1.4571 according to EN 10088 grade A4-70 or A4-80, according to EN-ISO 3506-1 |
| 2. | Hexagon nut M8 to M30 | EN-ISO 4032, Stainless steel according to threaded rod grade A4-70, A4-80, according to EN-ISO 3506-2 |
| 3. | Washer | EN ISO 887, EN-ISO 7089, EN-ISO 7093 or EN-ISO 7094, Stainless steel according to threaded rod |


| High corrosion resistant Stainless Steel 1.4529, 1.4565 | | |
|--|---------------------------|---|
| Part | Designation | Material and EN / ISO reference |
| 1. | Threaded rod M8 to M30 | High corrosion resistant Stainless Steel , 1.4529, 1.4565 according to EN 10088 grade A4-70 or A4-80, according to EN-ISO 3506-1 |
| 2. | Hexagon nut M8 to M30 | EN-ISO 4032, Stainless steel according to threaded rod grade A4-70, A4-80, according to EN-ISO 3506-2 |
| 3. | Washer | EN ISO 887, EN-ISO 7089, EN-ISO 7093 or EN-ISO 7094, Stainless steel according to threaded rod |

edilon)(sedra Dex[®]-EA 2K, edilon)(sedra Dex[®]-EA 2KC,
edilon)(sedra Dex[®]-EA 2KH

Product description
Threaded rod and materials

Annex A 3

Rebar Ø8, Ø10, Ø12, Ø16, Ø20, Ø25, Ø32

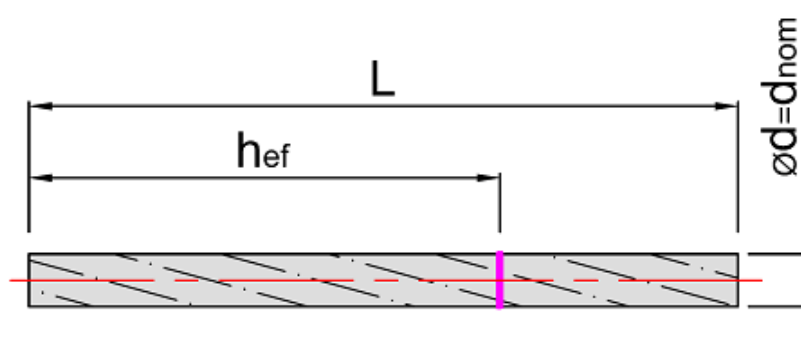

Standard commercial reinforcing bar with marked embedment depth

| Product form | | Bars and de-coiled rods | |
|--|--------------------------------|-------------------------|-----------------------|
| Class | | B | C |
| Characteristic yield strength f_{yk} or $f_{0,2k}$ (MPa) | | 400 to 600 | |
| Minimum value of $k = (f_t/f_y)_k$ | | $\geq 1,08$ | $\geq 1,15$ < 1,35 |
| Characteristic strain at maximum force ϵ_{uk} (%) | | $\geq 5,0$ | $\geq 7,5$ |
| Bendability | | Bend/Rebend test | |
| Maximum deviation from nominal mass (individual bar) (%) | Nominal bar size (mm) ≤ 8 | $\pm 6,0$ | |
| | > 8 | $\pm 4,5$ | |
| Bond: Minimum relative rib area, $f_{R,min}$ | Nominal bar size (mm) 8 to 12 | 0,040 | |
| | > 12 | 0,056 | |

edilon)(sedra Dex[®]-EA 2K, edilon)(sedra Dex[®]-EA 2KC,
edilon)(sedra Dex[®]-EA 2KH

Product description
Rebars and materials

Annex A 4

Specifications of intended use

Anchorage subject to:

- Static and quasi-static load.
- Seismic actions category C1 (max w = 0,5 mm): threaded rod size M10, M12, M16, M20, M24

Base materials

- Uncracked concrete.
- Cracked and uncracked concrete for threaded rod size M10, M12, M16, M20, M24
- Reinforced or unreinforced normal weight concrete of strength class C20/25 at minimum and C50/60 at maximum according EN 206-1:2000-12.

Temperature range:

- -40°C to +80°C (max. short. term temperature +80°C and max. long term temperature +50°C)

Use conditions (Environmental conditions)

- (X1) Structures subject to dry internal conditions (zinc coated steel, stainless steel, high corrosion resistance steel).
- (X2) Structures subject to external atmospheric exposure (including industrial and marine environment) and to permanently damp internal condition, if no particular aggressive conditions exist (stainless steel A4, high corrosion resistant steel).
- (X3) Structures subject to external atmospheric exposure and to permanently damp internal condition, if other particular aggressive conditions exist (high corrosion resistant steel).

Note: Particular aggressive conditions are e.g. permanent, alternating immersion in seawater or the splash zone of seawater, chloride atmosphere of indoor swimming pools or atmosphere with extreme chemical pollution (e.g. in desulphurization plants or road tunnels where de-icing materials are used).

Concrete conditions:

- I1 – installation in dry or wet (water saturated) concrete and use in service in dry or wet concrete.
- I2 – installation in water-filled (not sea water) and use in service in dry or wet concrete

Design:

- The anchorages are designed in accordance with the EN 1992-4 under the responsibility of an engineer experienced in anchorages and concrete work.
- Verifiable calculation notes and drawings are prepared taking account of the loads to be anchored. The position of the anchor is indicated on the design drawings.
- Anchorages under seismic actions (cracked concrete) have to be designed in accordance with EN 1992-4.

Installation:

- Hole drilling by rotary hammer drilling (electric drilling machine or driven by compressed air)
- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site.

Installation direction:

- D3 – downward and horizontal and upwards (e.g. overhead) installation

edilon)(sedra Dex[®]-EA 2K, edilon)(sedra Dex[®]-EA 2KC,
edilon)(sedra Dex[®]-EA 2KH

Intended use
Specifications

Annex B 1

Dispensing applicators:

A. 2 component coaxial cartridge:



(380 ml / 400 ml / 410 ml)



(380 ml / 400 ml / 410 ml)



(380 ml / 400 ml / 410 ml)



(380 ml / 400 ml / 410 ml)



(150 ml)

B. 2 component side by side cartridge :



(350 ml)



(825 ml)

**C. 2 component foil bag in a single piston cartridge :
D. 2 component foil bag in a single piston cartridge :**



(150 ml / 170 ml / 300 ml / 550 ml)



(150 ml / 300 ml)



(850 ml)

Steel-polymer cleaning brush :






**edilon)(sedra Dex®-EA 2K, edilon)(sedra Dex®-EA 2KC,
edilon)(sedra Dex®-EA 2KH**

Intended use
Applicator guns
Cleaning brush



Annex B 2

Installation instructions:

- 1 Drill the hole to the correct diameter and depth using a rotary percussion drilling machine.


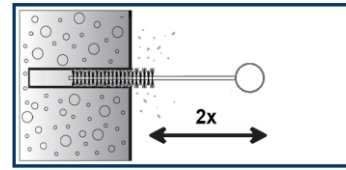
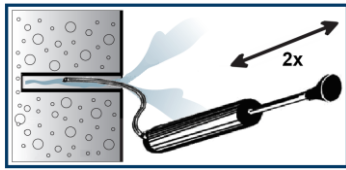
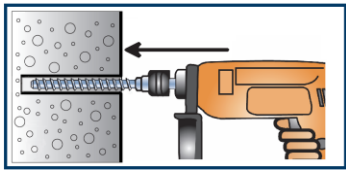


- 2 Thoroughly clean the hole in the following sequence using a steel-polymer cleaning brush with the required extensions and a hand blow pump:


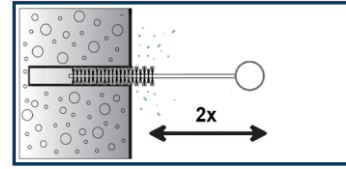
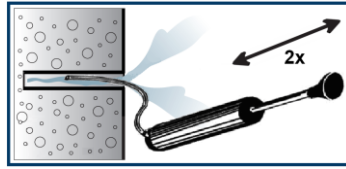


**Blow Clean x2.
Brush Clean x2.
Blow Clean x2.
Brush Clean x2.
Blow Clean x2.**


Remove standing water from the hole prior to cleaning to achieve maximum performance.

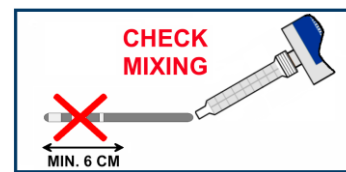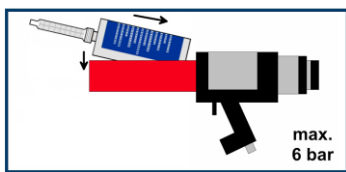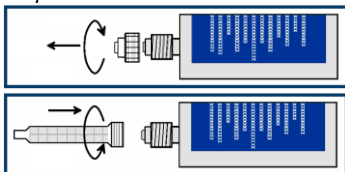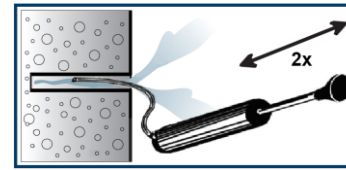

- 3 Select the appropriate static mixing nozzle for the installation, open the cartridge/cut foil pack and screw nozzle onto the mouth of the cartridge. Insert the cartridge into a good quality dispensing applicator (gun).
- 4 Extrude the first part of the cartridge to waste until an even colour has been achieved without streaking in the resin.
- 5 If necessary, cut the extension tube to the depth of the hole and push onto the end of the mixing nozzle, and fit the correct resin stopper to the other end.

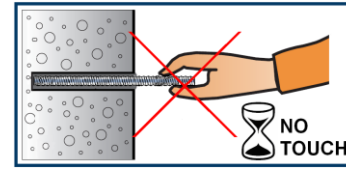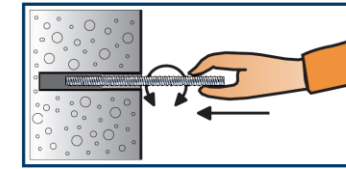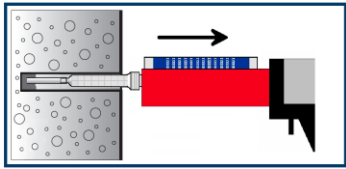

- 6 Insert the mixing nozzle (or the extension tube with resin stopper when necessary) to the bottom of the hole. Begin to extrude the resin and slowly withdraw the mixing nozzle from the hole ensuring that there are no air voids as the mixing nozzle is withdrawn. Fill the hole to approximately 1/2 to 3/4 full and withdraw the nozzle completely.
- 7 Insert the clean threaded rod or rebar, free from oil or other release agents, to the bottom of the hole using a back and forth twisting motion ensuring all the threads are thoroughly coated. Adjust to the correct position within the stated working time.
- 8 Excess resin will be expelled from the hole evenly around the steel element showing that the hole is full. This excess resin should be removed from around the mouth of the hole before it sets.
- 9 Leave the anchor to cure. Do not disturb the anchor until the appropriate loading time has elapsed depending on the substrate conditions and ambient temperature.
- 10 Attach the fixture and tighten the nut to the recommended torque. **Do not overtighten.**

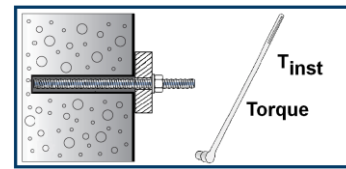

edilon)(sedra Dex[®]-EA 2K, edilon)(sedra Dex[®]-EA 2KC, edilon)(sedra Dex[®]-EA 2KH

Intended use
Installation procedure

Annex B 3

Table B1: Installation parameters of threaded rod

| Size | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 |
|--------------------------------------|------------------------|--|-----|-----|-----|-----------------|-----|-----|-----|
| Nominal drill hole diameter | $\varnothing d_0$ [mm] | 10 | 12 | 14 | 18 | 22 | 26 | 30 | 35 |
| Diameter of cleaning brush | d_b [mm] | 14 | 14 | 20 | 20 | 29 | 29 | 40 | 40 |
| Torque moment | $\max T_{fix}$ [Nm] | 10 | 20 | 40 | 80 | 150 | 200 | 240 | 275 |
| Depth of drill hole for $h_{ef,min}$ | $h_0 = h_{ef}$ [mm] | 64 | 80 | 96 | 128 | 160 | 192 | 216 | 240 |
| Depth of drill hole for $h_{ef,max}$ | $h_0 = h_{ef}$ [mm] | 160 | 200 | 240 | 320 | 400 | 480 | 540 | 600 |
| Minimum edge distance | c_{min} [mm] | 35 | 40 | 50 | 65 | 80 | 96 | 110 | 120 |
| Minimum spacing | s_{min} [mm] | 35 | 40 | 50 | 65 | 80 | 96 | 110 | 120 |
| Minimum thickness of member | h_{min} [mm] | $h_{ef} + 30 \text{ mm} \geq 100 \text{ mm}$ | | | | $h_{ef} + 2d_0$ | | | |

Table B2: Installation parameters of rebar

| Size | | Ø8 | Ø10 | Ø12 | Ø16 | Ø20 | Ø25 | Ø32 | |
|--------------------------------------|------------------------|--|-----|-----|-----|-----------------|-----|-----|--|
| Nominal drill hole diameter | $\varnothing d_0$ [mm] | 12 | 14 | 16 | 20 | 25 | 32 | 40 | |
| Diameter of cleaning brush | d_b [mm] | 14 | 14 | 19 | 22 | 29 | 40 | 42 | |
| Depth of drill hole for $h_{ef,min}$ | $h_0 = h_{ef}$ [mm] | 64 | 80 | 96 | 128 | 160 | 200 | 256 | |
| Depth of drill hole for $h_{ef,max}$ | $h_0 = h_{ef}$ [mm] | 160 | 200 | 240 | 320 | 400 | 500 | 640 | |
| Minimum edge distance | c_{min} [mm] | 35 | 40 | 50 | 65 | 80 | 100 | 130 | |
| Minimum spacing | s_{min} [mm] | 35 | 40 | 50 | 65 | 80 | 100 | 130 | |
| Minimum thickness of member | h_{min} [mm] | $h_{ef} + 30 \text{ mm} \geq 100 \text{ mm}$ | | | | $h_{ef} + 2d_0$ | | | |

Table B3: Cleaning

| All diameters |
|----------------|
| - 2 x blowing |
| - 2 x brushing |
| - 2 x blowing |
| - 2 x brushing |
| - 2 x blowing |

Table B4: Minimum curing time

| edilon)(sedra Dex®-EA 2K | | |
|--------------------------|-----------------|-----------|
| Application temperature | Processing time | Load time |
| +5 to +10°C | 10 mins | 145 mins |
| +10 to +15°C | 8 mins | 85 mins |
| +15 to +20°C | 6 mins | 75 mins |
| +20 to +25°C | 5 mins | 50 mins |
| +25 to +30°C | 4 mins | 40 mins |

Processing time refers to the highest temperature in the range.

Load time refers to the lowest temperature in the range.

Cartridge must be conditioned to a minimum +5°C.

| edilon)(sedra Dex®-EA 2KC | | |
|---------------------------|-----------------|-----------|
| Application temperature | Processing time | Load time |
| 0 to +5°C | 10 mins | 75 mins |
| +5 to +20°C | 5 mins | 50 mins |
| +20°C | 100 second | 20 mins |

Processing time refers to the highest temperature in the range.

Load time refers to the lowest temperature in the range.

Cartridge must be conditioned to a minimum 0°C.

| edilon)(sedra Dex®-EA 2KH | | |
|---------------------------|-----------------|-----------|
| Application temperature | Processing time | Load time |
| +15 to +20°C | 15 mins | 5 hours |
| +20 to +25°C | 10 mins | 145 mins |
| +25 to +30°C | 7.5 mins | 85 mins |
| +30 to +35°C | 5 mins | 50 mins |
| +35 to +40°C | 3.5 mins | 40 mins |

Processing time refers to the highest temperature in the range.

Load time refers to the lowest temperature in the range.

Cartridge must be conditioned to a minimum +15°C.

edilon)(sedra Dex®-EA 2K, edilon)(sedra Dex®-EA 2KC,
edilon)(sedra Dex®-EA 2KH

Intended use
Installation parameters
Curing time

Annex B 4

Table C1: Design method EN 1992-4
Characteristic values of resistance to tension load of threaded rod

| Steel failure – Characteristic resistance | | | | | | | | | | |
|--|---------------|------|-----------|------------|------------|------------|------------|------------|------------|------------|
| Size | | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 |
| Steel grade 4.6 | $N_{Rk,s}$ | [kN] | 15 | 23 | 34 | 63 | 98 | 141 | 184 | 224 |
| Partial safety factor | γ_{Ms} | [-] | 2,00 | | | | | | | |
| Steel grade 5.8 | $N_{Rk,s}$ | [kN] | 18 | 29 | 42 | 79 | 123 | 177 | 230 | 281 |
| Partial safety factor | γ_{Ms} | [-] | 1,50 | | | | | | | |
| Steel grade 8.8 | $N_{Rk,s}$ | [kN] | 29 | 46 | 67 | 126 | 196 | 282 | 367 | 449 |
| Partial safety factor | γ_{Ms} | [-] | 1,50 | | | | | | | |
| Steel grade 10.9 | $N_{Rk,s}$ | [kN] | 37 | 58 | 84 | 157 | 245 | 353 | 459 | 561 |
| Partial safety factor | γ_{Ms} | [-] | 1,33 | | | | | | | |
| Stainless steel grade A2-70, A4-70 | $N_{Rk,s}$ | [kN] | 26 | 41 | 59 | 110 | 172 | 247 | 321 | 393 |
| Partial safety factor | γ_{Ms} | [-] | 1,87 | | | | | | | |
| Stainless steel grade A4-80 | $N_{Rk,s}$ | [kN] | 29 | 46 | 67 | 126 | 196 | 282 | 367 | 449 |
| Partial safety factor | γ_{Ms} | [-] | 1,60 | | | | | | | |
| Stainless steel grade 1.4529 | $N_{Rk,s}$ | [kN] | 26 | 41 | 59 | 110 | 172 | 247 | 321 | 393 |
| Partial safety factor | γ_{Ms} | [-] | 1,50 | | | | | | | |
| Stainless steel grade 1.4565 | $N_{Rk,s}$ | [kN] | 26 | 41 | 59 | 110 | 172 | 247 | 321 | 393 |
| Partial safety factor | γ_{Ms} | [-] | 1,87 | | | | | | | |

| Combined pullout and concrete cone failure in uncracked concrete C20/25 | | | | | | | | | | | |
|--|-----------------|----------------------|-----------|------------|------------|------------|------------|------------|------------|------------|--|
| Size | | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 | |
| Characteristic bond resistance in uncracked concrete | | | | | | | | | | | |
| Dry and wet concrete | $\tau_{Rk,ucr}$ | [N/mm ²] | 10 | 9,5 | 9,5 | 9 | 8,5 | 8 | 6,5 | 5,5 | |
| Installation safety factor | γ_{inst} | [-] | 1,2 | | | | | | | 1,4 | |
| Water-filled hole | $\tau_{Rk,ucr}$ | [N/mm ²] | 8,5 | 7,5 | 7 | 7 | 6,5 | 5,5 | / | | |
| Installation safety factor | γ_{inst} | [-] | 1,4 | | | | | | | | |
| Factor for concrete C50/60 | ψ_c | [-] | 1 | | | | | | | | |

| Combined pullout and concrete cone failure in cracked concrete C20/25 | | | | | | | | | | | |
|--|----------------------------|----------------------|------------|------------|------------|------------|----------------------|--|--|--|--|
| Size | | | M10 | M12 | M16 | M20 | M24 | | | | |
| Characteristic bond resistance in cracked concrete | | | | | | | | | | | |
| Dry and wet concrete | $\tau_{Rk,cr}$ | [N/mm ²] | 4,5 | 4,5 | 4,5 | 4 | 4 | | | | |
| Installation safety factor | γ_{inst} | [-] | 1,2 | | | | | | | | |
| Water-filled hole | $\tau_{Rk,cr}$ | [N/mm ²] | 4,5 | 4,5 | 4,5 | 4 | 4 | | | | |
| Installation safety factor | γ_{inst} | [-] | 1,4 | | | | | | | | |
| Factor for cracked concrete | C30/37 C40/50 C50/60 | ψ_c | [-] | | | | 1,12 1,23 1,30 | | | | |

| Concrete cone failure | | | | | | | | | | |
|---|-------------|------|--------------|--|--|--|--|--|--|--|
| Factor for concrete cone failure for uncracked concrete | $k_{ucr,N}$ | [-] | 11 | | | | | | | |
| Factor for concrete cone failure for cracked concrete | $k_{cr,N}$ | | 7,7 | | | | | | | |
| Edge distance | $c_{cr,N}$ | [mm] | 1,5 h_{ef} | | | | | | | |

| Splitting failure | | | | | | | | | | |
|--------------------------|-------------|------|--------------|------------|------------|------------|------------|------------|------------|------------|
| Size | | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 |
| Edge distance | $c_{cr,sp}$ | [mm] | 1,5 h_{ef} | | | | | | | |
| Spacing | $s_{cr,sp}$ | [mm] | 3,0 h_{ef} | | | | | | | |

edilon)(sedra Dex[®]-EA 2K, edilon)(sedra Dex[®]-EA 2KC, edilon)(sedra Dex[®]-EA 2KH

Performances
Design according to EN 1992-4
Characteristic resistance for tension loads - threaded rod

Annex C 1

Table C2: Design method EN 1992-4
Characteristic values of resistance to tension load of rebar

| Steel failure – Characteristic resistance | | | | | | | | | |
|--|---------------|------|-----|-----|-----|-----|-----|-----|-----|
| Size | | | Ø8 | Ø10 | Ø12 | Ø16 | Ø20 | Ø25 | Ø32 |
| Rebar BSt 500 S | $N_{Rk,s}$ | [kN] | 28 | 43 | 62 | 111 | 173 | 270 | 442 |
| Partial safety factor | γ_{Ms} | [-] | 1,4 | | | | | | |

| Combined pullout and concrete cone failure in uncracked concrete C20/25 | | | | | | | | | |
|--|-----------------|----------------------|-----|-----|-----|-----|-----|-----|-----|
| Size | | | Ø8 | Ø10 | Ø12 | Ø16 | Ø20 | Ø25 | Ø32 |
| Characteristic bond resistance in uncracked concrete | | | | | | | | | |
| Dry and wet concrete | $\tau_{Rk,ucr}$ | [N/mm ²] | 11 | 9,5 | 9,5 | 9 | 8,5 | 8,5 | 5,5 |
| Installation safety factor | γ_{inst} | [-] | 1,2 | | | | | | |
| Water-filled hole | $\tau_{Rk,ucr}$ | [N/mm ²] | 11 | 9,5 | 9,5 | 9 | 8,5 | 8,5 | 5,5 |
| Installation safety factor | γ_{inst} | [-] | 1,4 | | | | | | |
| Factor for concrete C50/60 | ψ_c | [-] | 1 | | | | | | |

| Concrete cone failure | | | | | | | | | |
|----------------------------------|-------------|------|--------------|--|--|--|--|--|--|
| Factor for concrete cone failure | $k_{ucr,N}$ | [-] | 11 | | | | | | |
| Edge distance | $c_{cr,N}$ | [mm] | 1,5 h_{ef} | | | | | | |

| Splitting failure | | | | | | | | | |
|--------------------------|-------------|------|--------------|-----|-----|-----|-----|-----|-----|
| Size | | | Ø8 | Ø10 | Ø12 | Ø16 | Ø20 | Ø25 | Ø32 |
| Edge distance | $c_{cr,sp}$ | [mm] | 1,5 h_{ef} | | | | | | |
| Spacing | $s_{cr,sp}$ | [mm] | 3,0 h_{ef} | | | | | | |

edilon)(sedra Dex[®]-EA 2K, edilon)(sedra Dex[®]-EA 2KC,
edilon)(sedra Dex[®]-EA 2KH

Performances
Design according to EN 1992-4
Characteristic resistance for tension loads - rebar

Annex C 2

Table C3: Design method EN 1992-4
Characteristic values of resistance to shear load of threaded rod

| Steel failure without lever arm | | | | | | | | | |
|--|-------------------|-----------|------------|------------|------------|------------|------------|------------|------------|
| Size | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 |
| Steel grade 4.6 | $V_{Rk,s}$ [kN] | 7 | 12 | 17 | 31 | 49 | 71 | 92 | 112 |
| Partial safety factor | γ_{Ms} [-] | 1,67 | | | | | | | |
| Steel grade 5.8 | $V_{Rk,s}$ [kN] | 9 | 15 | 21 | 39 | 61 | 88 | 115 | 140 |
| Partial safety factor | γ_{Ms} [-] | 1,25 | | | | | | | |
| Steel grade 8.8 | $V_{Rk,s}$ [kN] | 15 | 23 | 34 | 63 | 98 | 141 | 184 | 224 |
| Partial safety factor | γ_{Ms} [-] | 1,25 | | | | | | | |
| Steel grade 10.9 | $V_{Rk,s}$ [kN] | 18 | 29 | 42 | 79 | 123 | 177 | 230 | 281 |
| Partial safety factor | γ_{Ms} [-] | 1,5 | | | | | | | |
| Stainless steel grade A2-70, A4-70 | $V_{Rk,s}$ [kN] | 13 | 20 | 30 | 55 | 86 | 124 | 161 | 196 |
| Partial safety factor | γ_{Ms} [-] | 1,56 | | | | | | | |
| Stainless steel grade A4-80 | $V_{Rk,s}$ [kN] | 15 | 23 | 34 | 63 | 98 | 141 | 184 | 224 |
| Partial safety factor | γ_{Ms} [-] | 1,33 | | | | | | | |
| Stainless steel grade 1.4529 | $V_{Rk,s}$ [kN] | 13 | 20 | 30 | 55 | 86 | 124 | 161 | 196 |
| Partial safety factor | γ_{Ms} [-] | 1,25 | | | | | | | |
| Stainless steel grade 1.4565 | $V_{Rk,s}$ [kN] | 13 | 20 | 30 | 55 | 86 | 124 | 161 | 196 |
| Partial safety factor | γ_{Ms} [-] | 1,56 | | | | | | | |
| Characteristic resistance of group of fasteners | | | | | | | | | |
| Ductility factor $k_7 = 1,0$ for steel with rupture elongation $A_5 > 8\%$ | | | | | | | | | |

| Steel failure with lever arm | | | | | | | | | |
|---|--------------------|-----------|------------|------------|------------|------------|------------|------------|------------|
| Size | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 |
| Steel grade 4.6 | $M^o_{Rk,s}$ [N.m] | 15 | 30 | 52 | 133 | 260 | 449 | 666 | 900 |
| Partial safety factor | γ_{Ms} [-] | 1,67 | | | | | | | |
| Steel grade 5.8 | $M^o_{Rk,s}$ [N.m] | 19 | 37 | 66 | 166 | 325 | 561 | 832 | 1125 |
| Partial safety factor | γ_{Ms} [-] | 1,25 | | | | | | | |
| Steel grade 8.8 | $M^o_{Rk,s}$ [N.m] | 30 | 60 | 105 | 266 | 519 | 898 | 1332 | 1799 |
| Partial safety factor | γ_{Ms} [-] | 1,25 | | | | | | | |
| Steel grade 10.9 | $M^o_{Rk,s}$ [N.m] | 37 | 75 | 131 | 333 | 649 | 1123 | 1664 | 2249 |
| Partial safety factor | γ_{Ms} [-] | 1,50 | | | | | | | |
| Stainless steel grade A2-70, A4-70 | $M^o_{Rk,s}$ [N.m] | 26 | 52 | 92 | 233 | 454 | 786 | 1165 | 1574 |
| Partial safety factor | γ_{Ms} [-] | 1,56 | | | | | | | |
| Stainless steel grade A4-80 | $M^o_{Rk,s}$ [N.m] | 30 | 60 | 105 | 266 | 519 | 898 | 1332 | 1799 |
| Partial safety factor | γ_{Ms} [-] | 1,33 | | | | | | | |
| Stainless steel grade 1.4529 | $M^o_{Rk,s}$ [N.m] | 26 | 52 | 92 | 233 | 454 | 786 | 1165 | 1574 |
| Partial safety factor | γ_{Ms} [-] | 1,25 | | | | | | | |
| Stainless steel grade 1.4565 | $M^o_{Rk,s}$ [N.m] | 26 | 52 | 92 | 233 | 454 | 786 | 1165 | 1574 |
| Partial safety factor | γ_{Ms} [-] | 1,56 | | | | | | | |
| Concrete pry-out failure | | | | | | | | | |
| Factor for resistance to pry-out failure | k_8 [-] | 2 | | | | | | | |

| Concrete edge failure | | | | | | | | | |
|------------------------------|----------------|--------------------------------|------------|------------|------------|------------|------------|------------|------------|
| Size | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 |
| Outside diameter of fastener | d_{nom} [mm] | 8 | 10 | 12 | 16 | 20 | 24 | 27 | 30 |
| Effective length of fastener | l_f [mm] | min (h_{ef} , 8 d_{nom}) | | | | | | | |

edilon)(sedra Dex[®]-EA 2K, edilon)(sedra Dex[®]-EA 2KC,
edilon)(sedra Dex[®]-EA 2KH

Performances
Design according to EN 1992-4
Characteristic resistance for shear loads - threaded rod

Annex C 3

Table C4: Design method EN 1992-4
Characteristic values of resistance to shear load of rebar

| Steel failure without lever arm | | | | | | | | |
|--|-------------------|-----------|------------|------------|------------|------------|------------|------------|
| Size | | Ø8 | Ø10 | Ø12 | Ø16 | Ø20 | Ø25 | Ø32 |
| Rebar BSt 500 S | $V_{Rk,s}$ [kN] | 14 | 22 | 31 | 55 | 86 | 135 | 221 |
| Partial safety factor | γ_{Ms} [-] | 1,5 | | | | | | |
| Characteristic resistance of group of fasteners | | | | | | | | |
| Ductility factor $k_7 = 1,0$ for steel with rupture elongation $A_5 > 8\%$ | | | | | | | | |

| Steel failure with lever arm | | | | | | | | |
|--|--------------------|-----------|------------|------------|------------|------------|------------|------------|
| Size | | Ø8 | Ø10 | Ø12 | Ø16 | Ø20 | Ø25 | Ø32 |
| Rebar BSt 500 S | $M^o_{Rk,s}$ [N.m] | 33 | 65 | 112 | 265 | 518 | 1013 | 2122 |
| Partial safety factor | γ_{Ms} [-] | 1,5 | | | | | | |
| Concrete pry-out failure | | | | | | | | |
| Factor for resistance to pry-out failure | k_8 [-] | 2 | | | | | | |

| Concrete edge failure | | | | | | | | |
|------------------------------|----------------|--------------------------------|------------|------------|------------|------------|------------|------------|
| Size | | Ø8 | Ø10 | Ø12 | Ø16 | Ø20 | Ø25 | Ø32 |
| Outside diameter of fastener | d_{nom} [mm] | 8 | 10 | 12 | 16 | 20 | 25 | 32 |
| Effective length of fastener | l_f [mm] | min (h_{ef} , 8 d_{nom}) | | | | | | |

edilon)(sedra Dex[®]-EA 2K, edilon)(sedra Dex[®]-EA 2KC,
edilon)(sedra Dex[®]-EA 2KH

Performances
Design according to EN 1992-4
Characteristic resistance for shear loads - rebar

Annex C 4

Table C5: Displacement of threaded rod under tension and shear load

| Size | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 |
|----------------------------|------|------|------|------|------|------|------|------|
| Tension load | | | | | | | | |
| Uncracked concrete | | | | | | | | |
| δ_{N0} [mm/kN] | 0,05 | 0,04 | 0,03 | 0,02 | 0,02 | 0,02 | 0,01 | 0,01 |
| $\delta_{N\infty}$ [mm/kN] | 0,11 | 0,09 | 0,06 | 0,04 | 0,03 | 0,02 | 0,02 | 0,02 |
| Cracked concrete | | | | | | | | |
| δ_{N0} [mm/kN] | | 0,08 | 0,09 | 0,05 | 0,03 | 0,02 | | |
| $\delta_{N\infty}$ [mm/kN] | | 0,51 | 0,32 | 0,18 | 0,13 | 0,11 | | |
| Shear load | | | | | | | | |
| δ_{V0} [mm/kN] | 0,48 | 0,30 | 0,20 | 0,11 | 0,10 | 0,08 | 0,06 | 0,05 |
| $\delta_{V\infty}$ [mm/kN] | 0,72 | 0,45 | 0,30 | 0,17 | 0,14 | 0,12 | 0,10 | 0,08 |

Table C6: Displacement of rebar under tension and shear load

| Size | Ø8 | Ø10 | Ø12 | Ø16 | Ø20 | Ø25 | Ø32 |
|----------------------------|------|------|------|------|------|------|------|
| Tension load | | | | | | | |
| Uncracked concrete | | | | | | | |
| δ_{N0} [mm/kN] | 0,04 | 0,03 | 0,02 | 0,02 | 0,01 | 0,01 | 0,01 |
| $\delta_{N\infty}$ [mm/kN] | 0,09 | 0,07 | 0,05 | 0,03 | 0,02 | 0,01 | 0,01 |
| Shear load | | | | | | | |
| δ_{V0} [mm/kN] | 0,05 | 0,04 | 0,03 | 0,02 | 0,01 | 0,01 | 0,01 |
| $\delta_{V\infty}$ [mm/kN] | 0,08 | 0,06 | 0,05 | 0,03 | 0,02 | 0,01 | 0,01 |

edilon)(sedra Dex[®]-EA 2K, edilon)(sedra Dex[®]-EA 2KC,
edilon)(sedra Dex[®]-EA 2KH

Performances
Displacement

Annex C 5

Table C7: Characteristic values of resistance under seismic action category C1 for threaded rods

| Size | | | M10 | M12 | M16 | M20 | M24 |
|--|---------------------|----------------------|------|-----|-----|-----|-----|
| Tension load | | | | | | | |
| Steel failure | | | | | | | |
| Characteristic resistance grade 4.6 | $N_{Rk,s,eq}$ | [kN] | 23 | 34 | 63 | 98 | 141 |
| Partial safety factor | γ_{Ms} | [-] | 2,00 | | | | |
| Characteristic resistance grade 5.8 | $N_{Rk,s,eq}$ | [kN] | 29 | 42 | 79 | 123 | 177 |
| Partial safety factor | γ_{Ms} | [-] | 1,50 | | | | |
| Characteristic resistance grade 8.8 | $N_{Rk,s,eq}$ | [kN] | 46 | 67 | 126 | 196 | 282 |
| Partial safety factor | γ_{Ms} | [-] | 1,50 | | | | |
| Characteristic resistance grade 10.9 | $N_{Rk,s,eq}$ | [kN] | 58 | 84 | 157 | 245 | 353 |
| Partial safety factor | γ_{Ms} | [-] | 1,33 | | | | |
| Characteristic resistance A2-70, A4-70 | $N_{Rk,s,eq}$ | [kN] | 41 | 59 | 110 | 172 | 247 |
| Partial safety factor | γ_{Ms} | [-] | 1,87 | | | | |
| Characteristic resistance A4-80 | $N_{Rk,s,eq}$ | [kN] | 46 | 67 | 126 | 196 | 282 |
| Partial safety factor | γ_{Ms} | [-] | 1,60 | | | | |
| Characteristic resistance 1.4529 | $N_{Rk,s,eq}$ | [kN] | 41 | 59 | 110 | 172 | 247 |
| Partial safety factor | γ_{Ms} | [-] | 1,50 | | | | |
| Characteristic resistance 1.4565 | $N_{Rk,s,eq}$ | [kN] | 41 | 59 | 110 | 172 | 247 |
| Partial safety factor | γ_{Ms} | [-] | 1,87 | | | | |
| Combined pull-out and concrete cone failure | | | | | | | |
| Dry and wet concrete | $\tau_{Rk,p,eq,C1}$ | [N/mm ²] | 3,5 | 3,5 | 3,5 | 3,5 | 3,5 |
| Water-filled hole | $\tau_{Rk,p,eq,C1}$ | [N/mm ²] | 3,5 | 3,5 | 3,5 | 3,5 | 3,5 |
| Shear load | | | | | | | |
| Steel failure without lever arm | | | | | | | |
| Characteristic resistance grade 4.6 | $V_{Rk,s,eq}$ | [kN] | 7 | 10 | 23 | 30 | 40 |
| Partial safety factor | γ_{Ms} | [-] | 1,67 | | | | |
| Characteristic resistance grade 5.8 | $V_{Rk,s,eq}$ | [kN] | 9 | 13 | 28 | 38 | 51 |
| Partial safety factor | γ_{Ms} | [-] | 1,25 | | | | |
| Characteristic resistance grade 8.8 | $V_{Rk,s,eq}$ | [kN] | 14 | 21 | 45 | 61 | 81 |
| Partial safety factor | γ_{Ms} | [-] | 1,25 | | | | |
| Characteristic resistance grade 10.9 | $V_{Rk,s,eq}$ | [kN] | 18 | 26 | 56 | 76 | 101 |
| Partial safety factor | γ_{Ms} | [-] | 1,50 | | | | |
| Characteristic resistance A2-70, A4-70 | $V_{Rk,s,eq}$ | [kN] | 12 | 18 | 39 | 53 | 71 |
| Partial safety factor | γ_{Ms} | [-] | 1,56 | | | | |
| Characteristic resistance A4-80 | $V_{Rk,s,eq}$ | [kN] | 14 | 21 | 45 | 61 | 81 |
| Partial safety factor | γ_{Ms} | [-] | 1,33 | | | | |
| Characteristic resistance 1.4529 | $V_{Rk,s,eq}$ | [kN] | 12 | 18 | 39 | 53 | 71 |
| Partial safety factor | γ_{Ms} | [-] | 1,25 | | | | |
| Characteristic resistance 1.4565 | $V_{Rk,s,eq}$ | [kN] | 12 | 18 | 39 | 53 | 71 |
| Partial safety factor | γ_{Ms} | [-] | 1,56 | | | | |
| Factor for annular gap | α_{gap} | [-] | 0,5 | | | | |

Note: Rebars are not qualified for seismic design

edilon)(sedra Dex[®]-EA 2K, edilon)(sedra Dex[®]-EA 2KC,
edilon)(sedra Dex[®]-EA 2KH

Performances
Reduction factors for seismic design

Annex C 6